


SECTION A-A

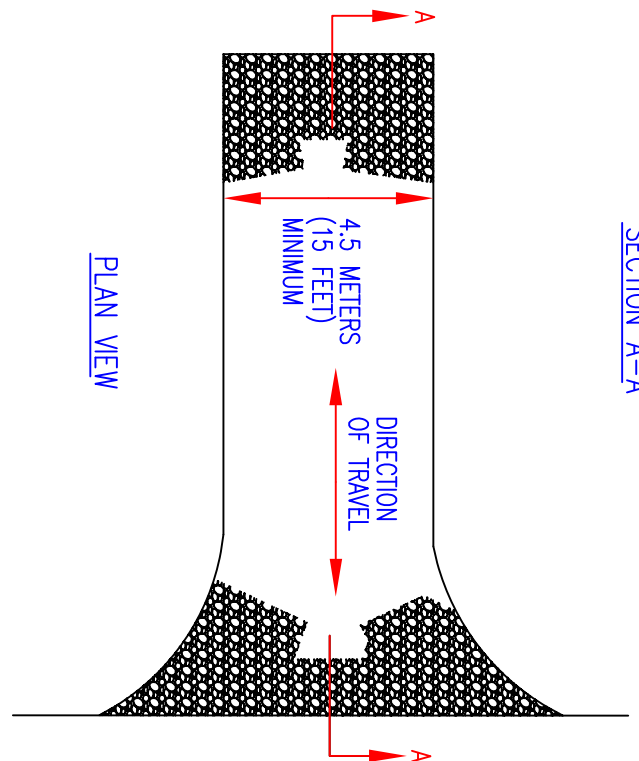

PLAN VIEW

NOTES

1. STABILIZED CONSTRUCTION SITE ACCESS SHALL BE CONSTRUCTED OF 75-125 MM (3-6 INCH) WASHED, ANGULAR ROCK. MATERIAL SHALL BE PLACED TO A MINIMUM THICKNESS OF 150 MM (6 INCHES).
2. LENGTH OF ENTRANCE SHALL BE A MINIMUM OF 15 METERS (50 FEET). WIDTH SHALL BE A MINIMUM OF 4.5 METERS (15 FEET) OF GREATER IF NECESSARY TO COVER ALL VEHICULAR INGRESS AND EGRESS. PROVIDE AMPLE TURNING RADII.
3. THE ENTRANCE SHALL BE KEPT IN GOOD CONDITION BY OCCASIONAL TOP DRESSING WITH MATERIAL AS SPECIFIED IN NOTE 1.
4. ACCESSES SHALL BE INSPECTED WEEKLY DURING PERIODS OF HEAVY USAGE, MONTHLY DURING NORMAL USAGE, AND AFTER EACH RAINFALL, WITH MAINTENANCE PROVIDED AS NECESSARY. PERIODIC TOP DRESSING SHALL BE DONE AS NEEDED.



<p>CITY OF OROVILLE DEPARTMENT OF PUBLIC WORKS</p>		
<p>STANDARD FOR STABILIZED CONSTRUCTION SITE ACCESS</p>		
<p>DRAWN BY: SG</p>	<p>RICK WALLS, P.E. DIRECTOR OF PUBLIC WORKS DEPARTMENT</p>	<p>SHEET 1 OF 1 SD-09</p>