


LEVELING NUT (BOTTOM), BASE PLATE (MIDDLE). SECURING NUT (TOP) AND NUT COVER (NOT SHOWN). BOLT PATTERN, NUMBER, AND SIZE OF BOLTS PER LIGHT POLE MANUFACTURER'S SPECIFICATIONS)



NOTES:

1. PRECAST FOUNDATIONS
 - A. MAY BE USED
 - B. MUST BE BACKFILLED WITH A ONE-SACK CEMENT PER CUBIC YARD CEMENT SAND SLURRY.
2. BOLT - COVER SHALL BE PROVIDED.
3. WITH PRECAST FOUNDATION, THE POLE MAY BE GROUNDED VIA A BARE NO. 4 SOLID COPPER WIRE CLAMPED TO A 1/2" X 10 FOOT LONG GROUNDING ROD INSTALLED IN PULL BOX. (SEE PULL BOX DETAIL).
4. INSTALLATION SHALL INCLUDE SECURING NUTS, LEVELING NUTS, WASHERS, AND NUT COVERS.

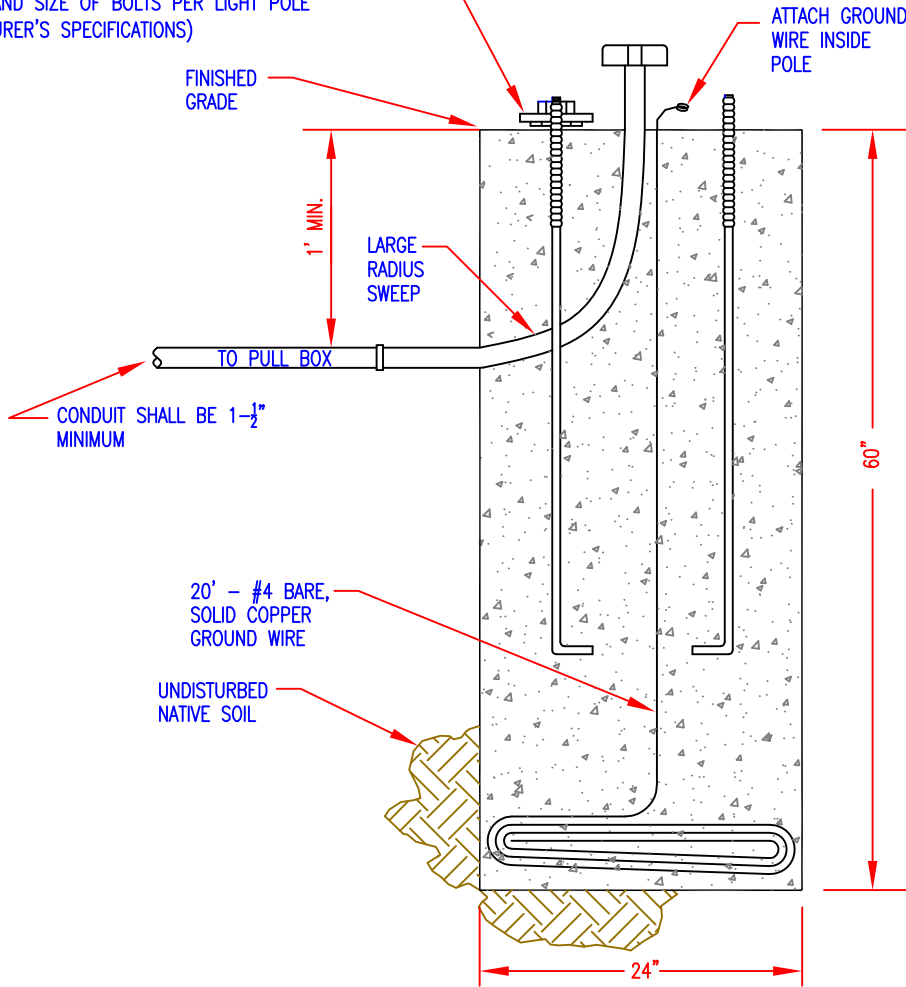

CITY OF OROVILLE
DEPARTMENT OF PUBLIC WORKS

STANDARD FOR
STREET LIGHT POLE FOOTING

DRAWN BY
SG

RICK WALLS, P.E.
DIRECTOR OF PUBLIC WORKS DEPARTMENT

SHEET
1 OF 1
ST-26