


## PEDESTRIAN RAMP DETAIL

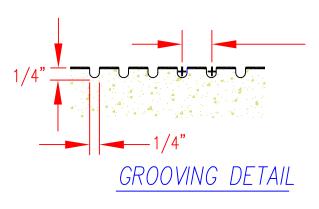

APPROX. 3/4" EXCEPT APPROX. 1-1/2" ON SLOPING PORTION OF RAMP.

## **NOTES:**

- 1. SEE ST-17 FOR GENERAL NOTES REGARDING RAMPS.
- 2. RAMPS SHALL BE POURED MONOLITHICALLY.
- 3. CONCRETE SHALL BE 3,000 PSI AT 28 DAYS.



## CITY OF OROVILLE DEPARTMENT OF PUBLIC WORKS

STANDARD FOR
MID BLOCK PEDESTRIAN RAMP

DRAWN BY. SG

RICK WALLS, P.E. DIRECTOR OF PUBLIC WORKS DEPARTMENT

SHEET 1 OF 1 ST-16